


Wenatchee School District
Maintenance & Operations
1001 Circle St.
Wenatchee, WA. 98801

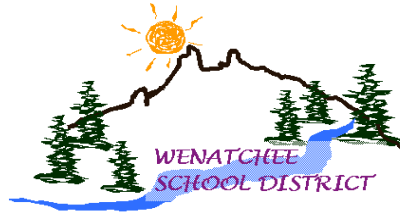

Phone (509) 663-0555 ex.221
Fax (509) 663-0244

May 13, 2008

Addendum 1

Emergency Generator Wenatchee High School

- (1) Contractor to install a 3/4" conduit (for control wiring included in contract) along with power wiring conduit from transfer switches to generator control panel.
- (2) Contractor to install a dedicated 120 volt circuit from panel P14 (in main electrical room) to generator block heater. Provide new 20 amp single pole breaker.
- (3) The new breakers in the generator panel board must be "electronic, adjustable with instantaneous trip" type.